

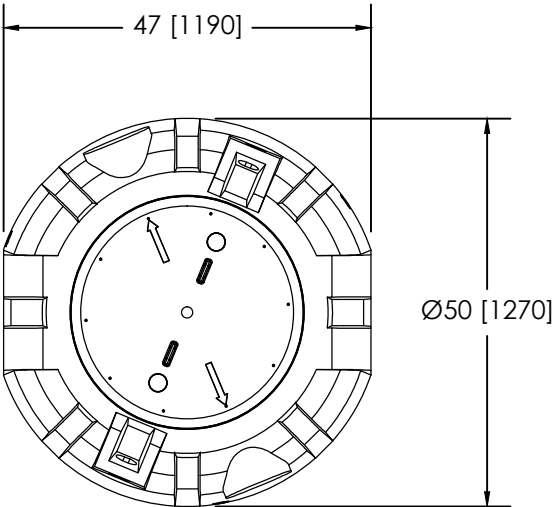


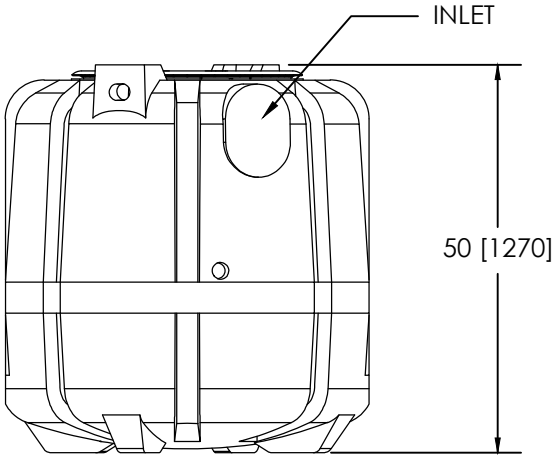

PLAN

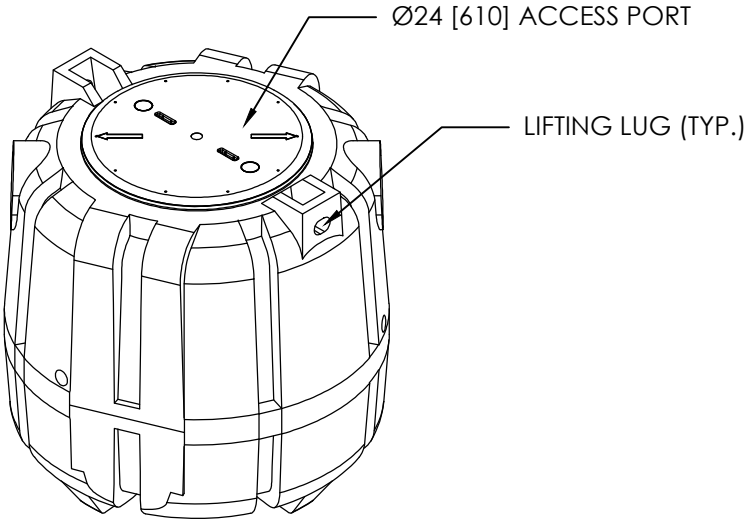

PROFILE

PARAMETER	UNITS U.S. [METRIC]	VALUE
EFFECTIVE (TOTAL) CAPACITY	gal [L]	313 [1184]
ACCESS PORT AREA	in ² [m ²]	452 [0.29]



INFILTRATOR SYSTEMS INC.
6 Business Park Rd. Old Saybrook, CT 06475
(800) 221-4436

TW-300
PUMP TANK CONFIGURATION

Drawn by: LB MS	DWG NO. 1	Date: 05-24-10
SCALE Not To Scale	Checked by: DL	SHEET 1 of 1

1. TANK MARKINGS WILL INCLUDE: MANUFACTURER NAME, LIQUID CAPACITY, MANUFACTURE DATE, MAXIMUM BURIAL DEPTH, AND STATE DESIGNATED SERIAL NUMBER.
2. EXTERIOR OF MANHOLE COVER INCLUDES THE FOLLOWING WARNING: "DANGER DO NOT ENTER POISON GASES" WRITTEN IN ENGLISH, FRENCH, AND SPANISH.
3. MAXIMUM BURIAL DEPTH IS 48 IN [1219 MM].
4. DIMENSIONS ON DRAWING SHOWN IN INCHES [MILLIMETERS].
5. NOMINAL WALL THICKNESS IS 0.7 INCHES [17.8 MM] ±0.25 INCHES [6.3 MM].