


TIGHTENING TORQUE FOR TERMINAL BLOCKS IS 4.425 in-lbs.

PANEL MODEL #
CP-001-4-0001


CAUTION:
Remove jumper for 240V operation. Failure to remove jumper may cause equipment damage or electrical hazard.

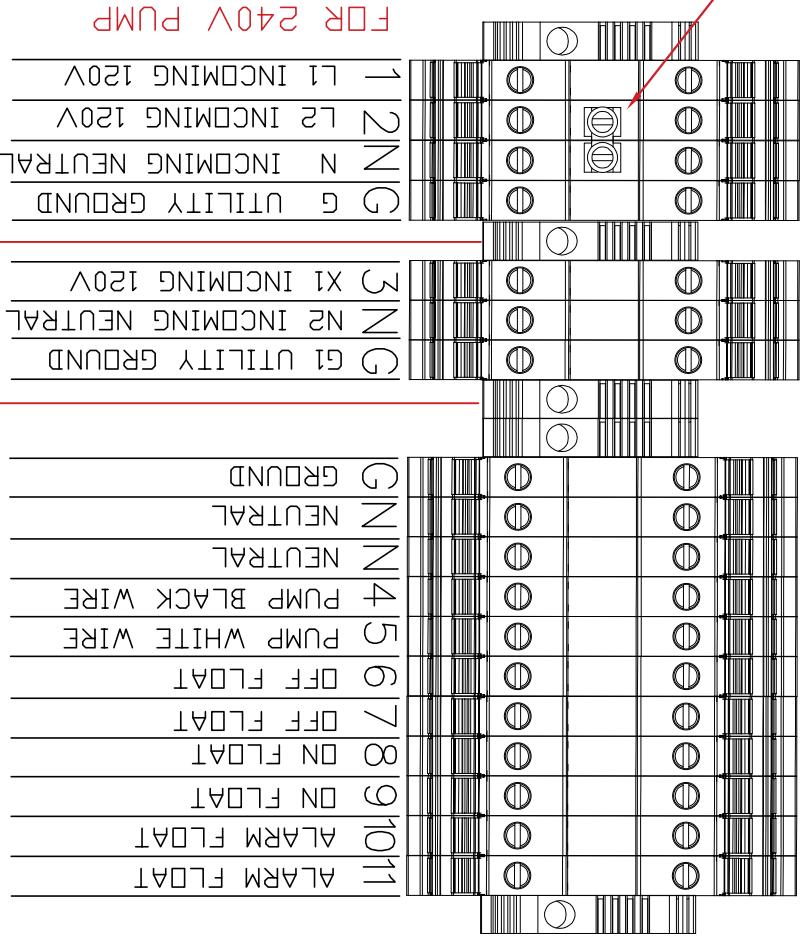

FDR 240V PUMP

FDR 120V PUMP

SEPERATE ALARM FEED

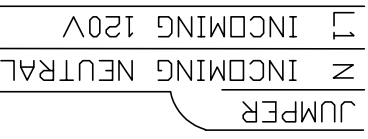

TERMINAL CONNECTION DIAGRAM

TERMIAL BLDCKS
PINDOUT DIAGRAM
26-10 AWG, 600V, 60C