


TIGHTENING TORQUE FOR TERMINAL BLOCKS IS 4.425 in-lbs.

PANEL MODEL #

CP-001-6-0002

CAUTION: Jumper pin installed is for 120v operation. DO NOT REMOVE.

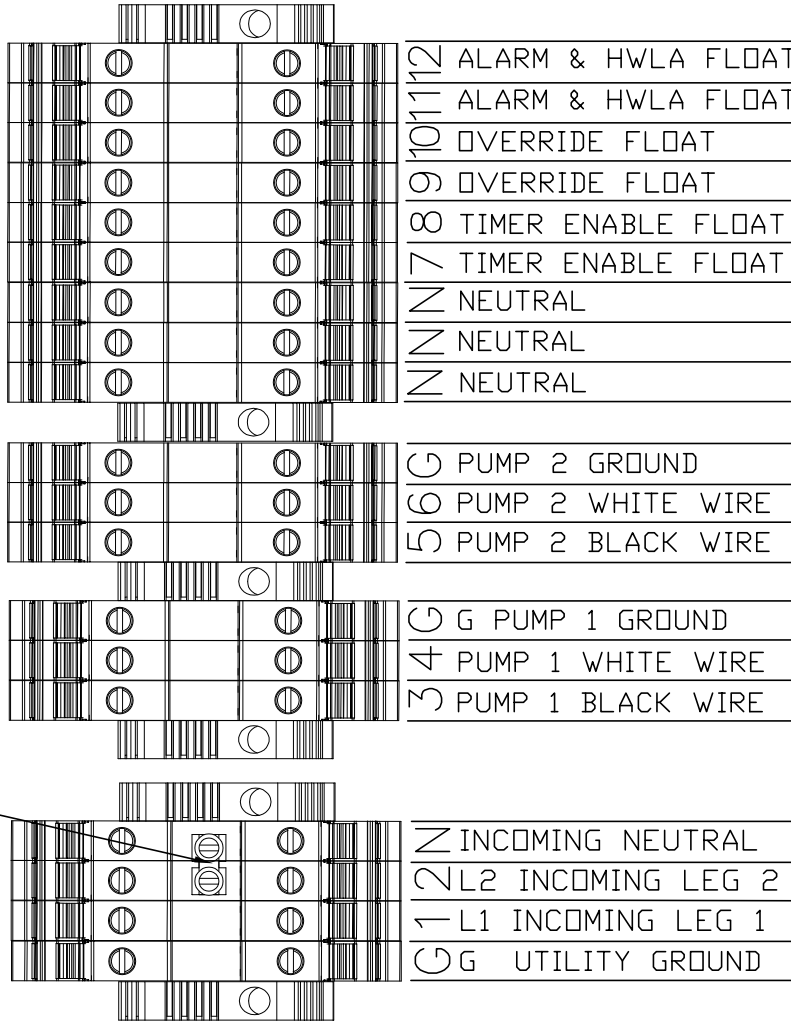

TERMINAL CONNECTION DIAGRAM


TERMINAL BLOCKS
PINOUT DIAGRAM

120V CONFIGURATION

TIGHTENING TORQUE FOR TERMINAL BLOCKS IS 4.425 in-lbs.

PANEL MODEL #
CP-001-6-0002

CAUTION: Jumper pin installed is for 120V operation. MUST REMOVE PIN FOR 240V OPERATION.

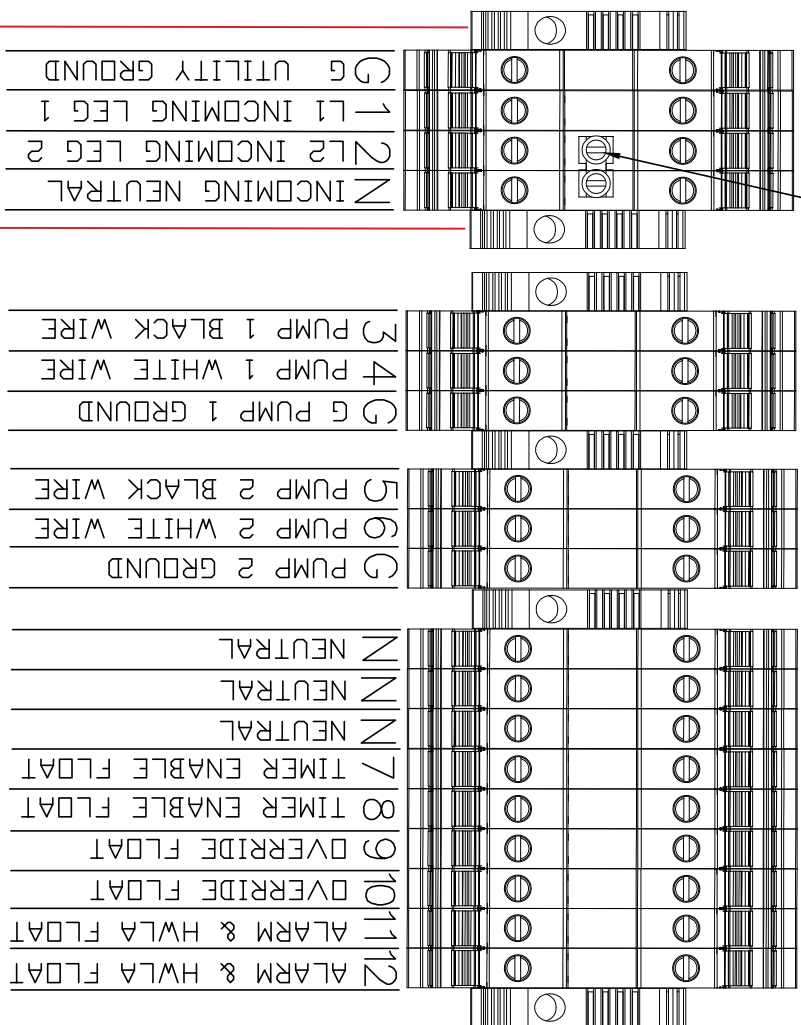

MAIN PANEL FEED
240V

TERMINAL CONNECTION DIAGRAM

TERMINAL BLOCKS
PINOUT DIAGRAM

240V CONFIGURATION