


TIGHTENING TORQUE FOR TERMINAL BLOCKS IS 4.425 in-lbs.

PANEL MODEL #

CP-001-4-0002

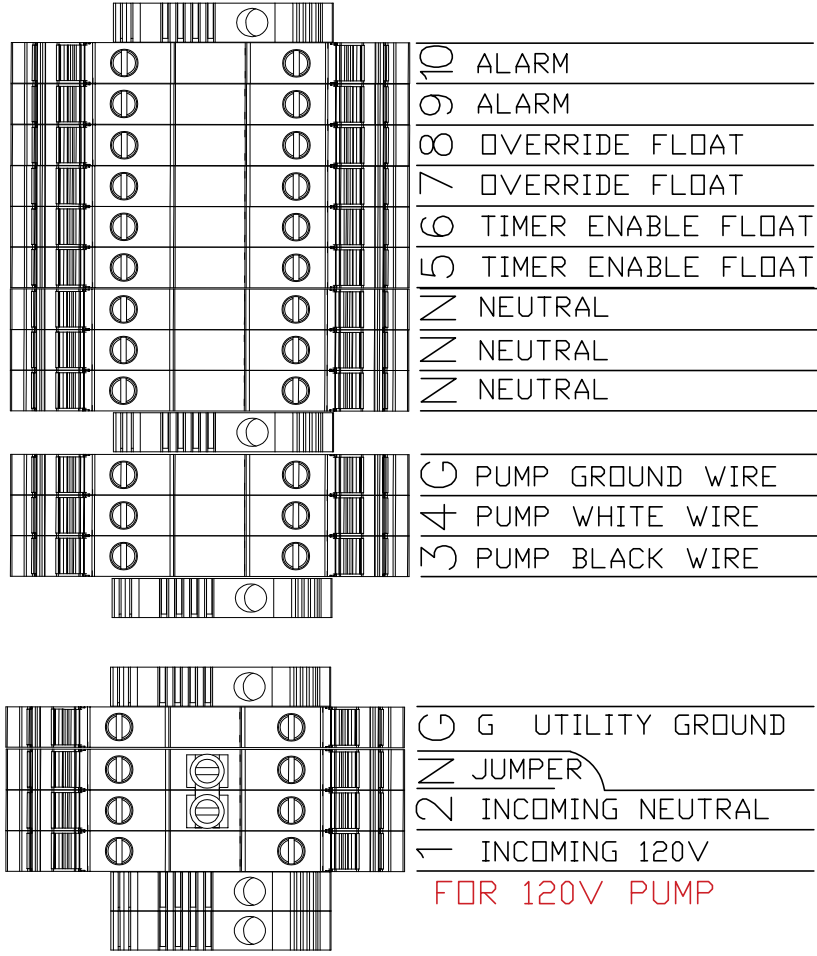

FOR 120V PUMP

CAUTION:
 Remove jumper for 240V operation. Failure to remove jumper may cause equipment damage or electrical hazard.

G UTILITY GROUND
 N INCOMING NEUTRAL
 L2 INCOMING 120V
 L1 INCOMING 120V

FOR 240V PUMP

TERMINAL CONNECTION DIAGRAM

TERMINAL BLOCKS
 PINOUT DIAGRAM

120/240V CONFIGURATION